




## How-To:

# Replace the Kodiak Pressure Transducer

Please follow the steps below to replace the Lytron G03, H03, and J03 Kodiak Pressure Transducer. Pictures 1 and 2 show the location of the pressure transducer from different views.

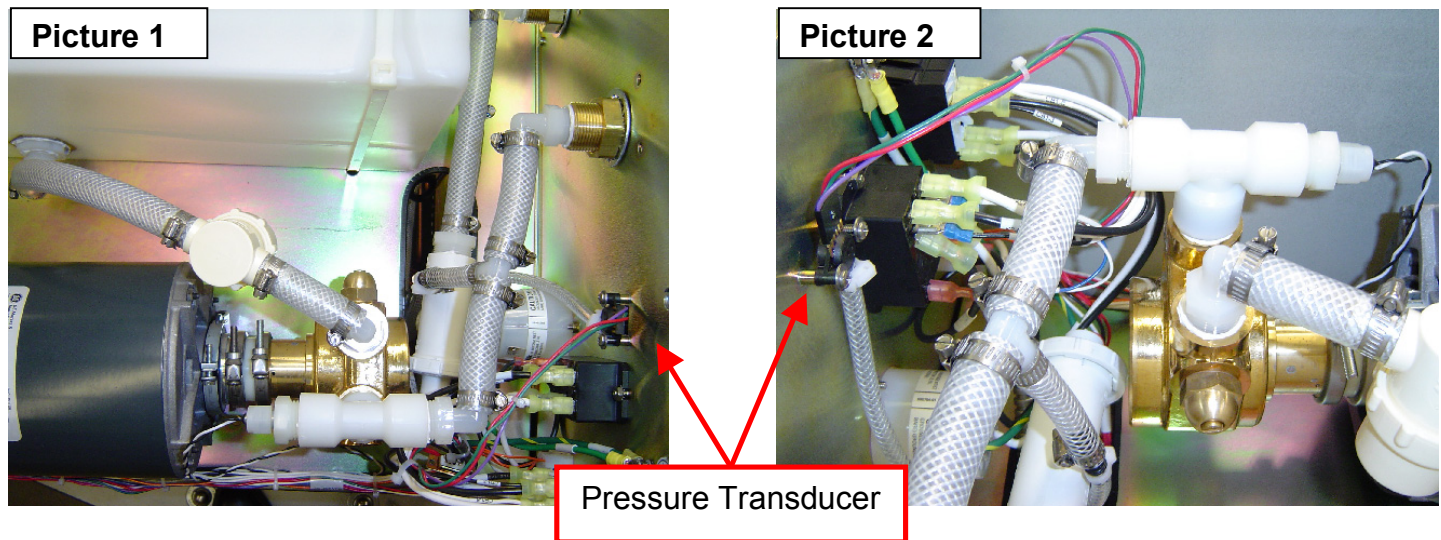

### Safety Precautions:



- Always turn the unit "OFF" and unplug it from its power supply

### Required Tools:

- Philips screwdriver

### Procedure:

1. Remove the top cover and the side panels of the chiller to access the internal components.
2. To remove the pressure transducer, remove the electrical connector as shown on picture 3.
3. Remove the two fastening screws shown on picture 4.

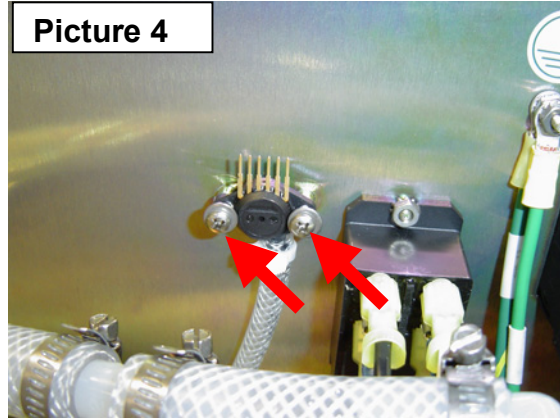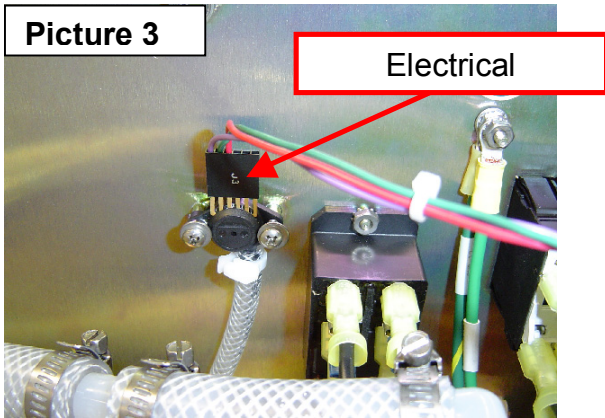

4. Gently remove the hose clamp and the hose.
5. Replace the pressure transducer and follow the above steps in reverse order. Please note that the wires on the electrical connector need to be on the left hand side, as shown in picture 5. Reversing the electrical connector will prevent the chiller from displaying pressure. Please be careful not to damage the pressure transducer when installing the hose and the hose clamp. Also do not over tighten the fastening screws.
5. Turn the chiller on and verify its proper operation.

Electrical  
connector wires  
on left hand side,  
when facing the  
chiller

